

SIGNALOMFORMER FOR SPENNING

P20Z01321000

Signalomformer 0-60VAC/4-20mA. 24 VAC/DC drift

- Inn: 0-600 V AC eller 0-400 V DC (6 omr)
- Ut: 4-20 mA eller 0-10 V
- 20-40 VAC/DC eller 90-250 VAC/DC
- Eks: 0-100 V DC, 0-250 V AC



PRODUKTBESKRIVELSE

Signalomformer / Måleverdiomformer for AC eller DC spenning med enten 4-20 mA eller 0-10 V ut.

Serien finnes oppdelt i flere modeller:

0-60, 0-100, 0-150, 0-250, 0-400, 0-500 og 0-600 V AC .

+/-100, +/-250, +/-400, 0-100, 0-250, 0-400 V DC.

Signalomformeren bestilles med ønsket inn- og utsignal. Ingen ytterligere justering behøves, noe som gjør installasjonen rask og enkel. Det finnes LED indikering for tilkoblet driftsspenning.

To valg av driftsspenning finnes: 20-40 VAC/20-60 VDC eller 85-253 VAC/90-260 VDC.

Vi viser bare et utvalg på vår nettside. Kontakt oss for andre innspenninger og utsignal.

TEKNISKE DATA

INNGANGSDATA

Måleområde, spenning	0-60 VAC
Måleområde	0-60 VAC

UTGANGSDATA

Last maks (4-20 mA)	500 Ω
---------------------	--------------

MEKANISK DATA

IP-klasse	IP20
-----------	------

Vekt 0,125 kg

Tilkoblingsareal maks. 1,5 mm²

GENERELL DATA

Driftspenning DC maks. 60 V

Driftspenning DC min. 20 V






Driftspenning AC min. 20 V

Driftspenning AC maks. 40 V

Effektforbruk 4 VA

Temperaturområde fra -20 °C

Temperaturområde til 55 °C

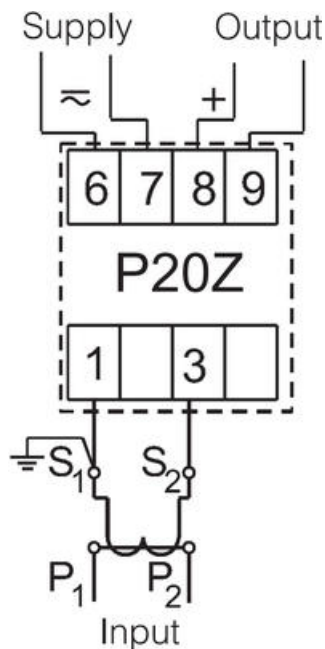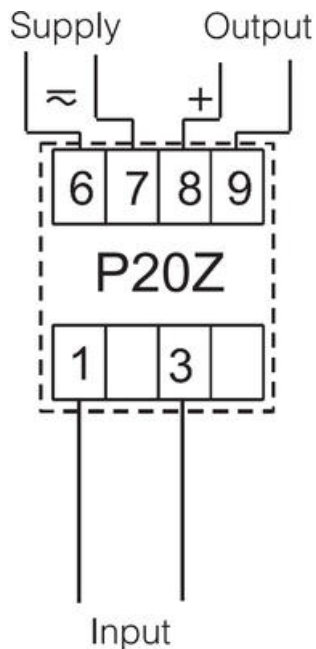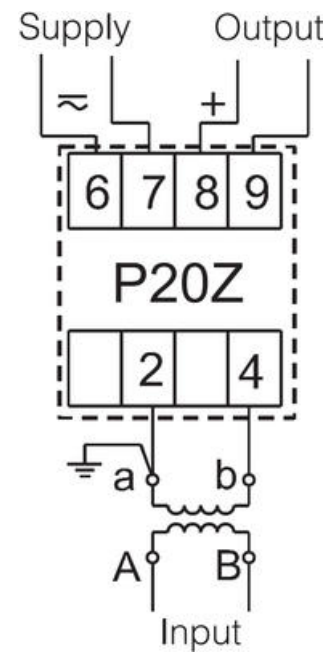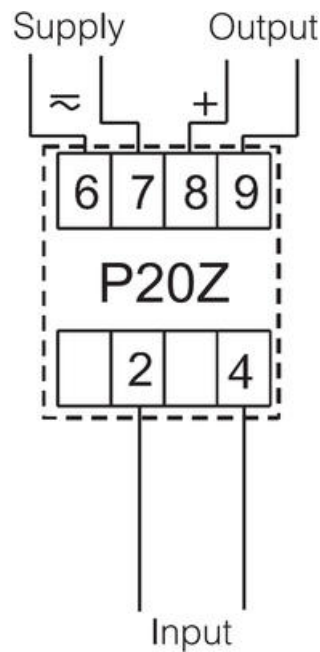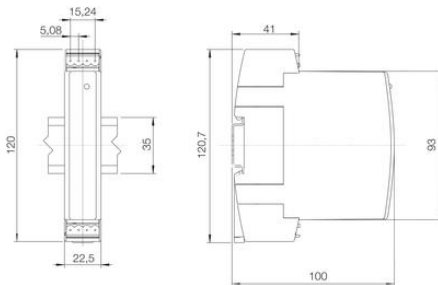

EXECUTION CODES

TRANSUCER P20Z -	XX	X	X	X	XX	X
Input range						
0... 60 V	01					
0... 100 V	02					
0... 150 V	03					
0... 250 V	04					
0... 400 V	05					
0... 500 V	06					
0... 600 V	07					
0... 1 A	08					
0... 5 A	09					
Output range						
0... 5 mA	1					
0... 20 mA	2					
4... 20 mA	3					
0... 10 V	4					
Supply voltage						
85...253 V a.c./d.c.	1					
20...40 V a.c./d.c.	2					
Kind of terminals						
inseparable with screws	1					
socket-plug with screws	2					
Kind of execution						
standard	00					
custom-made	XX					
Acceptance tests						
without additional requirements	8					
with an extra quality inspection certificate	7					
acc. user's agreement *	X					

